

Water Quality Report

Annual Water Quality Report
June 2016



DOYON UTILITIES LLC

www.doyonutilities.com
Office: 907-338-3600
Public Water System ID# 2212039



www.jber.af.mil
Office: 907-552-3985
Public Water System ID# 2211423



JBER's Drinking Water Mission

A water utility seldom takes the opportunity to tell its customers about all they are doing to produce exceptional quality drinking water in conjunction with the myriad of additional things the utility does to ensure public safety. All too often, we concentrate only on our mission of producing water that goes through a rigorous testing and quality control process before being introduced into a water distribution system for customers. Beyond that, we don't broadcast what we are doing. In essence, we fail to "toot our own horn."

The Environmental Protection Agency (EPA) and the Alaska Department of Environmental Conservation (ADEC) have given us an opportunity to tell the rest of our story in the form of this annual Consumer Confidence Report. Doyon Utilities and 673d Bioenvironmental Engineering are pleased to jointly prepare this comprehensive report for our customers who work and reside on JBER. Our goals and efforts have been closely coordinated with the environmental staff from both JBER and DU to provide you with a complete picture of the water quality program.

As you will clearly see from the report, the water you consume is of exceptional quality and exceeds the standards established by the US Environmental Protection Agency.

Who are we?

While there are two Public Water Systems on JBER, the two systems are connected and in essence operate as a continuous system from the water plant to the consumer. The commonality of the two systems allows us to efficiently operate as a team in order to serve our most deserving customers; the military personnel and civilian employees assigned to the joint installation. This report will provide many technical aspects of our water quality but just as importantly, it will allow us an opportunity to let you know some of the work going on behind the scenes.

Doyon Utilities owns and operates utilities located on the Richardson side of JBER. This relationship was initially established through a Utility Privatization Contract with the Army at the

former Ft. Richardson and later expanded due to the joint basing action that consolidated Ft. Richardson and Elmendorf AFB to become JBER. As the water purveyor on the Richardson side, Doyon manages the water plant and distribution lines, while conducting a myriad of bacteriological and chemical tests to ensure all quality standards are met.

Once the water reaches the Elmendorf side, the 673d Civil Engineer Group (CEG) and 673d Medical Group (MDG) Bioenvironmental Engineering flight take over. CEG provides distribution system oversight, while Bioenvironmental Engineering monitors water quality. This includes additional testing of the system for bacteriological contamination, with each major loop and/or population area sampled at least once per month.

Additionally, several select chemical contaminants are re-sampled to verify results seen on JBER, as required by the State of Alaska. The results of Bioenvironmental Engineering's samples, in conjunction with those obtained by Doyon Utilities, are used to ensure base-wide water quality.

In order to ensure long term reliability of the water source, we have conducted assessment studies to determine areas where we need to focus our resources. Our water treatment plant received continuous oversight of the drinking water it produces. The quality of water you drink is

superb and our standards will not be compromised. Testing results from 2015 are included in this report and from the data, you can be confident that the dedicated staff of highly qualified and state-certified professional water treatment operators will protect the integrity and quality of your

drinking water. After all, our reputation is only as good as the quality of water we produce and we value that reputation!


We are proud to be partners in preparation and publication of this annual Consumer Confidence Report and welcome any suggestions on how to make it more informative in the future. As a side note, we encourage you to use the water you need but don't needlessly use water. Conservation of any resource is important and we ask you to do your part in this effort.



Doyon Utilities operates and provides utility service for the United States Army in Alaska at Fort Wainwright, Fort Greely and JBER (Joint Base Elmendorf-Richardson).

Where does our water come from?

JBER's drinking water is obtained from surface-water drainage and three local wells on JBER. Large debris is removed from the raw surface-water prior to it entering the treatment plant where it undergoes several conventional water treatment processes. The plant is designed to produce approximately 7 million gallons of water per day – enough to fill over 8 Olympic competition-size pools! All of our treatment processes are controlled and monitored by an interconnected set of computers. Because groundwater is a very high quality source of raw water, the only treatment necessary is disinfection. Each well is equipped with its own in-line chlorination equipment to ensure that water enters the distribution system free from any microbial contamination. The finished water is tested several times a day to ensure that pH, chlorine residuals, and fluoride are at appropriate levels.

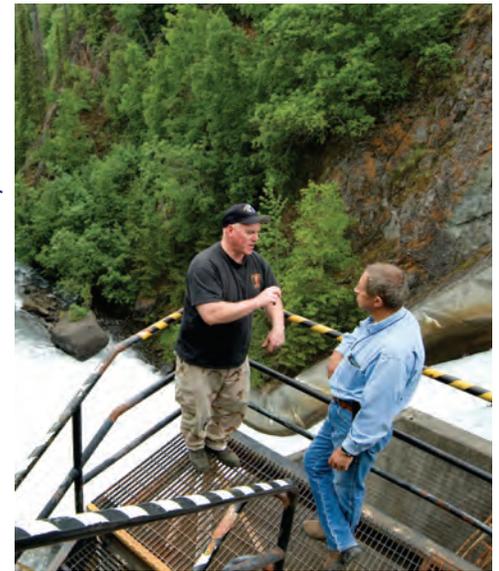

Two of Doyon Utilities' water treatment operators at the surface-water source.

Doyon Utilities' water treatment operators discussing treatment at the plant.

Water Testing and Your Health

The sources of drinking water (both tap and bottled) include rivers, lakes, ponds, reservoirs, springs and wells. As water travels over the surface of the land or underground, it can dissolve naturally occurring minerals. In some cases, water can pick up radioactive material, or substances resulting from the presence of animals or human activity.

Although our water supply may contain some of these contaminants, it is important to know that these substances are either removed completely or reduced to a safe level before it arrives at your tap.

Contaminants that may be present in source water include:

- Microbial Contaminants, such as viruses and bacteria, which may come from sewage treatment facilities, septic systems, agricultural livestock operations and wildlife.
- Inorganic Contaminants, such as salts and metals, which may naturally occur or result from urban storm water runoff, industrial or domestic wastewater discharge, oil and gas production or farming.
- Pesticides and Herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.
- Radioactive Contaminants, which may occur naturally or result from oil and gas production and mining activities.
- Organic Contaminants, including synthetic and volatile organic compounds, which are by-products of industrial processes and

petroleum production, and may also come from gas stations, urban storm water runoff and septic systems.

In order to ensure tap water is safe to drink, the EPA prescribes regulations, which limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration regulations establish limits for contaminants in bottled water, which must provide the same protection for public health. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's Safe Drinking Water Hotline at 1-800-426-4791.

Some people in the general population may be more vulnerable than others to contaminants in drinking water. Immuno-compromised persons such as those with cancer undergoing chemotherapy, persons who have undergone organ transplants, persons with HIV/AIDS or other immune system disorders, some elderly and infants can be particularly at risk of infection. These people should seek advice about drinking water from their health care providers. EPA/CDC published guidelines on appropriate means to lessen the risk of infection are available from the Safe Drinking Water Hotline (800-426-4791).

We're happy to answer any other questions about our water quality. For general information or for water quality questions call Doyon Utilities site management office at 907-338-3600 or JBER Bioenvironmental Engineering at 907-552-3985. Other Resources:

Environmental Protection Agency's Safe Drinking Water Hotline: 1-800-426-4791.

Water Quality Data for community water systems throughout the United States is available at www.waterdata.com.



Drinking Water Test Results

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water hotline at 1-800-426-4791.

The table lists the Regulated Contaminants required to be monitored by the EPA that were detected in your water. While most monitoring is required annually, some contaminants are sampled less frequently. The Stage 2 Disinfection By-Product Rule requires testing for trihalomethanes and haloacetic acids at locations in the distribution system that produce the highest concentration of these two categories of compounds.

This sampling was done quarterly in 2015. All the substances found were present in quantities less than the EPA's limits for safe drinking water.

If you would like to view a complete listing of test results, please call JBER Bioenvironmental Engineering at 907-552-3985 or Kathleen Hook at 907-455-1540.

Substance	Sample Date	Violation Y/N	Detected Range JBER-R <small>PWS 2212039</small>	Detected Range JBER-E <small>PWS 2211423</small>	MCL	MCLG	Likely Source of Contamination
Microbiological Contaminants							
Coliform Bacteria	Monthly 2015 All Samples Passed	N ¹	—	—	Two or more positive samples/month	0	Naturally present in the environment
Turbidity	Daily 2015	N	Highest single measurement 0.22 NTU 100% of samples <0.3 NTU	Tested by JBER-R	TT = 1 NTU TT = % of samples <0.3 NTU	NA	Soil Run-off
Inorganic Contaminants							
Fluoride	Daily 2015	N	0.00 - 0.96 ppm	Tested by JBER-R	4 ppm	4 ppm	Chemical Additive
Nitrate Bldg 28004 Well 2 Well 3	Annually 1/12-15 1/6/15 1/6/15	N	0.3 ppm 0.5 ppm 0.6 ppm	Tested by JBER-R	10 ppm	10 ppm	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits
Golf Course Munitions Storage Hillberg Ski Lodge	Annually 3/3/15	N	Tested by JBER-E	<0.10 ppm <0.10 ppm <0.10 ppm	10 ppm	10 ppm	
Asbestos	Every 9 years	N	<0.115 um 2/25/14	<0.119 um 11/18/14	7MFL	7MFL	Decay of asbestos-cement water mains; Erosion of natural deposits
Free Residual Chlorine	Daily 2015	N	0.243 - 1.90 ppm	0.2-2.0 ppm	MRDL 4 ppm	MRDLG 4 ppm	Water additive used to control microbes
Lead ²	Every 3 years	N	90th Percentile <1.0 ppb June 2015	90%=<2.0 ppb Sept/Oct 2013	AL=15 ppb	0	Corrosion of household plumbing systems
Copper ²	Every 3 years	N	90th Percentile 0.0265 ppm June 15	90%=0.095 ppm Sept/Oct 2013	AL=1.3 ppm	1.3 ppm	Corrosion of household plumbing system

¹ Due to clerical error, 1 sample out of 20 was not submitted in November 2015. Water system was brought back into compliance 1 December 2015 when sample was submitted.

² Samples were obtained from numerous locations, the 90th percentile for lead and copper were below EPA actions levels (AL). For a complete list of sites contact JBER Bioenvironmental at 907-552-3985 or Kathleen Hook at 907-455-1540

JBER takes weekly water quality samples as well as additional samples during every line break. Be assured Bioenvironmental Engineering and Doyon Utilities make every effort to ensure the water provided to JBER is safe for consumption and the installation is notified should water quality deteriorate.

Some residents may experience brown or rusty water coming from their faucets; more often in older housing. This is usually caused by a higher con-

centration of minerals in the water. This does not mean that the water is not safe. Any brown or rusty water that does not run clear after running faucets for several minutes should be reported to housing maintenance.

Another common occurrence is white cloudy water. This is due to more oxygen in the water and most often noticed during colder months. Any cloudy water that does not clear up after sitting for a couple minutes should be reported to housing maintenance.

Substance	Sample Date	Violation Y/N	Detected Range JBBER-R PWS 2212039	Detected Range JBBER-E PWS 2211423	MCL	MCLG	Likely Source of Contamination
Organic Contaminants							
Total Organic Carbon	Monthly 2015	N	Raw Water Range <0.50-1.55 Treated Water Range <0.500-0.998	Tested by JBBER-R	TT	TT	Naturally present in the environment
Total Trihalomethanes AAFES Gas Station Bldg 986	Samples taken Quarterly	N	Average 13.0 ppb Range 2.0 - 27.9 ppb	—	80 ppb	NA	By-product of drinking water chlorination
381st Intel Bldg 18220 Family CC Bldg 5091	Samples taken Quarterly 2014	N	—	Average 16.1 ppb Range 6.8 - 25 ppb	80 ppb	NA	
Total Haloacetic Acids AAFES Gas Bldg 986	Samples taken Quarterly	N	Average 16.2 ppb Range 4.1 - 32.0 ppb	—	60 ppb	NA	By-product of drinking water chlorination
381st Intel Bldg 18220 Family CC Bldg 5091	Samples taken Quarterly 2014	N	—	Average 16.29 ppb Range 6.2 - 25 ppb	60 ppb	NA	
Synthetic Organic Chemicals (SOC)							
Di (2-ethylhexyl phthalate)	Sampled Quarterly 2015	N	Highest reported level 0.7 ppb Range <0.6 ppb - 0.7	Tested by JBBER-R	6 ppb	0	Discharge from rubber and chemical factories
Radionuclides							
Alpha emitters	BY ADEC Request 7/9/09	N	Highest level reported 1.1 pCi/L Range 0.0-1.1 pCi/L	Tested by JBBER-R	15 pCi/L	0	Erosion of natural deposits
Beta/photon emitters	BY ADEC Request 7/9/09	N	Highest level reported 3.7 mrem/yr Range 0.0 - 3.7 mrem/yr	Tested by JBBER-R	4 mrem/yr	0	Decay of natural and man-made deposits
Combined radium (226, 228)	7/9/09	N	Highest level reported 1.3 pCi/L Range 0.4 - 1.3 pCi/L	Tested by JBBER-R	5 pCi/L	0	Erosion of natural deposits

Terms and Abbreviations Used

Action Level (AL): The concentration of a contaminant which, when exceeded, triggers treatment or other requirements which a water system must follow.

JBBER-E: Joint Base Elmendorf Richardson – Elmendorf side. Public Water System (PWS) 2211423

JBBER-R: Joint Base Elmendorf Richardson – Richardson side. Public Water System (PWS) 2212039

Maximum Contaminant Level (MCL): The highest

level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available technology.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which, there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water.

There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contamination.

MFL: Million fibers per liter >10 µm

mrem/yr: Millirems per year.

Nephelometric Turbidity Units (NTU): The unit of measurement for turbidity samples.

Not Applicable (NA): When NA is used in the range column, only one sample was taken, therefore, no range exists.

Not Detectable (ND): The contaminant is below the detectable limits of the testing method.

pCi/L: Picocuries per liter.

ppb: Parts per billion or micrograms per liter.

ppm: Parts per million or milligrams per liter.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.



Lead/Copper in Drinking Water

The EPA Safe Drinking Water Act requires public water systems to test water samples from its customers to determine lead and copper levels. If present, elevated levels of lead can cause serious health problems, especially in pregnant women and young children.

Lead and Copper samples were collected at numerous locations on JBER-R during June 2015, and at JBER-E during September and October 2013. During both sampling events the 90th percentiles were below the EPA Action Levels.

Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. There is nothing in the treatment process that would introduce lead into the water; therefore, the water is tested at the individual service locations. If abnormal levels of lead or copper are detected in the water supply, residents will be notified and JBER will initiate action to correct the problem.

One method to minimize the risk of lead or copper contamination is to let the tap water run for 30 seconds to two minutes to flush any water that has been sitting for several hours.

It is important to use this approach for drinking water or cooking water. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

Hydrant Maintenance

Hydrant maintenance is a top priority for our utility! Twice a year, April and September, we visit each hydrant in our system. We test the water flow at each hydrant and make sure each one is working properly.

This is our way to provide superior fire protection to ensure the safety and wellbeing of our consumers.



Source Water Assessment

For the last several years, the ADEC has been working on assessments of the vulnerability of the water sources that provide water to all of the public water systems in Alaska. The source water assessment for JBER's Water Treatment Plant has been completed and is available for review by contacting JBER Bioenvironmental Engineering at 907-552-3985 or Kathleen Hook at 907-455-1540.



JBER Receives Awards

For the first time, JBER received two Alaska Water Wastewater Management Association (AWWMA) Awards:

- Large Water System of the Year Award: Recognizing the performance of a water system serving 2,500 or more individuals or producing 250,000 gallons per day or more of water.
- Marty Lang Award: Recognizing Nate Engebretson, Doyon Utilities JBER Water Treatment Plant Operator.

AWWMA Awards Info: www.awwma.org/awards/

This Consumer Confidence Report summarizes drinking water quality for the period between January 1, 2015 and December 31, 2015. In order to conserve natural resources and make it more efficient to distribute, an electronic copy can be downloaded at www.doyonutilities.com or www.jber.af.mil. Hard copies are also available at Doyon Utilities or by contacting Kathleen Hook at 907-455-1540.



Jack Willis and Nate Engebretson (center) received the Large Water System of the Year award from the American Water Works Association (AWWA) & Water Environment Federal (WEF) Visiting Officers during the AWWMA annual conference.

Left to Right:

John Donahue: AWWA representative and Past-President (2015-2016). General Manager, North Park Illinois Public Water District, a groundwater system with 33,000 customers.

Jack Willis: Doyon Utilities JBER Water Treatment Plant Superintendent

Nate Engebretson: Doyon Utilities JBER Water Treatment Plant Operator

Ed McCormick: WEF representative and Past-President (2014-2015). Manager, Wastewater Engineering at East Bay Municipal Utility District in Oakland, California.